



PURCHASING DEPARTMENT  
1772 County Services Parkway  
Marietta, Georgia 30008-4012  
(770) 528-8400/FAX (770) 528-1154

Mark Kohntopp  
INTERIM DIRECTOR

---

**ADDENDUM No. 2**

**Sealed Bid # 12-5658**

**Mountain View Aquatic Center Air Quality Improvements and Interior Renovations  
Cobb County Parks, Recreation and Cultural Affairs Department**

**DATE: APRIL 4, 2012**

Page 1 of 3

The following addendum hereby amends and/or modifies the Proposal Documents and specifications as originally issued for this project. All proposers are subject to the provisions of this Addendum.

**Proposers shall acknowledge receipt of this addendum.**

Include this original form inside your proposal package.

**This Addendum consists of:**

- **Questions submitted in writing**
- **Clarifications to specifications**

**All bids must be received before 12:00 (noon) by the Bid Opening date. Bids shall be delivered to Cobb County Purchasing Department, 1772 County Services Parkway, Marietta, GA 30008.**

**Electronic / faxed bid response will not be considered.**

---

**I acknowledge that I have received Addendum No. 2**

**Sealed Bid # 12-5658**

**Mountain View Aquatic Center Air Quality Improvements and Interior Renovations  
Cobb County Parks, Recreation and Cultural Affairs Department**

\_\_\_\_\_  
Company Name

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Date Sent to Purchasing

\_\_\_\_\_  
Please Print Name

Please sign, date, and return this form ONLY to:  
Cobb County Purchasing Department  
Fax #: 770-528-1154  
E-Mail: [purchasing@cobbcounty.org](mailto:purchasing@cobbcounty.org)

Addendum 2  
Cobb County Sealed Bid #12-5658  
Mountain View Aquatic Center Air Quality Improvements and Interior Renovations

A. Drawings

1. Refer to drawing M-2. The underground piping associated with PDHU-1 and PDHU-2 shall be revised per the attached sketch MSK-4 titled UNDERGROUND PIPING REVISIONS.
2. Refer to drawing M-2. Paved areas removed to accommodate piping and the existing hole outside the roll up door (previously excavated for the purpose of pipe repair) shall be filled with suitable soil backfill and 4" of 3000 psi concrete over 4" of compacted graded aggregate base (GAB). Soil backfill material under the GAB shall be compacted to 98% of the maximum density determined by ASTM D698 in 6" lifts by hand operated (hand tamp) equipment. No heavy equipment or rollers will be allowed. Contractor shall take special precautions to ensure pipe is not damaged by backfill operations. Place and compact initial backfill of subbase material, free of particles larger than 1 inch in any dimension, to a height of 12 inches over the utility pipe or conduit. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of utility piping or conduit to avoid damage or displacement of piping or conduit.


B. Questions and Answers received to date

Question: A 330M coal tar epoxy is specified for the bulkhead. This product is not recommended for use in "potable water" applications. Swimming pools are considered potable water. Please confirm that this product should be used. Answer: The specified product per Specification Section 13000, 300 M Coal Tar Epoxy, shall be used.

Question: The specs call for bidder to supply 10 new lane lines. Assuming the pool is a ten lane pool the owner would need either 9 or 11 floating lane lines. Please clarify. Answer: Provide 11 new lane lines. The third bullet on page 13000-2 of the specifications shall be revised to require 11 new lane lines in lieu of 10 new lane lines.

Question: The specifications call for 300m to be applied to the inside structure of the bulkhead. We want to confirm that, when the work is completed and the bulkhead grating is reassembled and reinstalled that none of this material (300M) will be visible. Answer: When the work is complete, the 300M coal tar epoxy shall not be visible on the outside of the structure. It may be possible to look through the spaces between the grates and see the coating applied to the internal stainless steel.

FRENCH DRAIN SHALL CONSISTS OF A PIT 36' X 36' X 24' DEEP FILLED WITH COURSE GRAVEL. THE DRAIN PIPE SHALL EXTEND INTO THE PIT NOT LESS THAN 6 INCHES BELOW GRADE AND SHALL BE SECURELY ANCHORED IN PLACE.

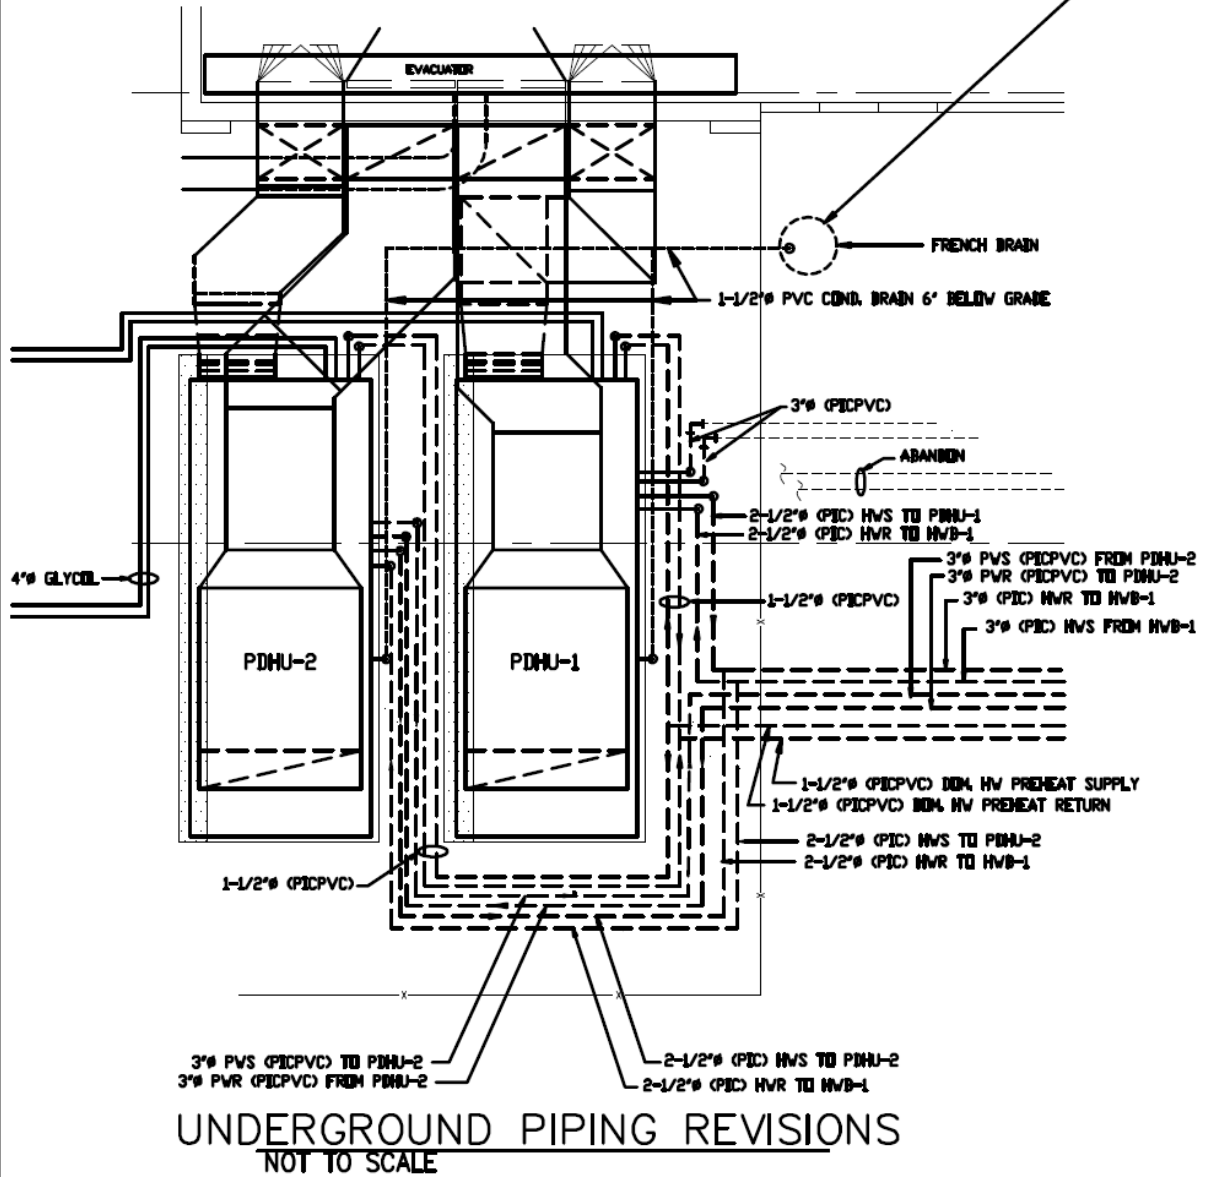

COBB COUNTY MAINTAIN VIEW  
AQUATIC CENTER

KIRKPATRICK ENGINEERS  
2141 KINGSTON CT., SUITE 111  
MARIETTA, GEORGIA 30067  
PHONE (770) 933-8842

ADDENDUM NO. 2

4/3/2012

MSK-4